IPN Radom

DIAGRAM SYMBOL LEGEND	
DISPLAY	DESCRIPTION
—//—	POWER WIRE
———	CONTROL WIRE
———	REF. PIPE

CONT.No		PAGE	1 / 1

CITY MULTI

SYSTEM SCHEMATIC DWG.

Additional refrigerant charge is needed depending on the size and length of extended piping. Please refer the amount of pre-charge and the formula of calculation which is mentioned on the data book.
1.25mm²(16 AWG) : 1.25mm²(16 AWG) or more. 0.75mm²(20 AWG) : between 0.5mm²(24 AWG) and 0.75mm²(20 AWG).

PIPING LIST		
SYMBOL	BRANCH PIPE MODEL NAME	
J1	CMY-Y102LS-G2	
J2	CMY-Y102SS-G2	
SYMBOL	LIQUID PIPE/GAS PIPE SIZE	
P1	9.52 / 22.2	
P2	9.52 / 15.88	
P3	6.35 / 12.7	
P4	9.52 / 19.05	

12.7mm for liquid pipe of P250 unit over 90m.

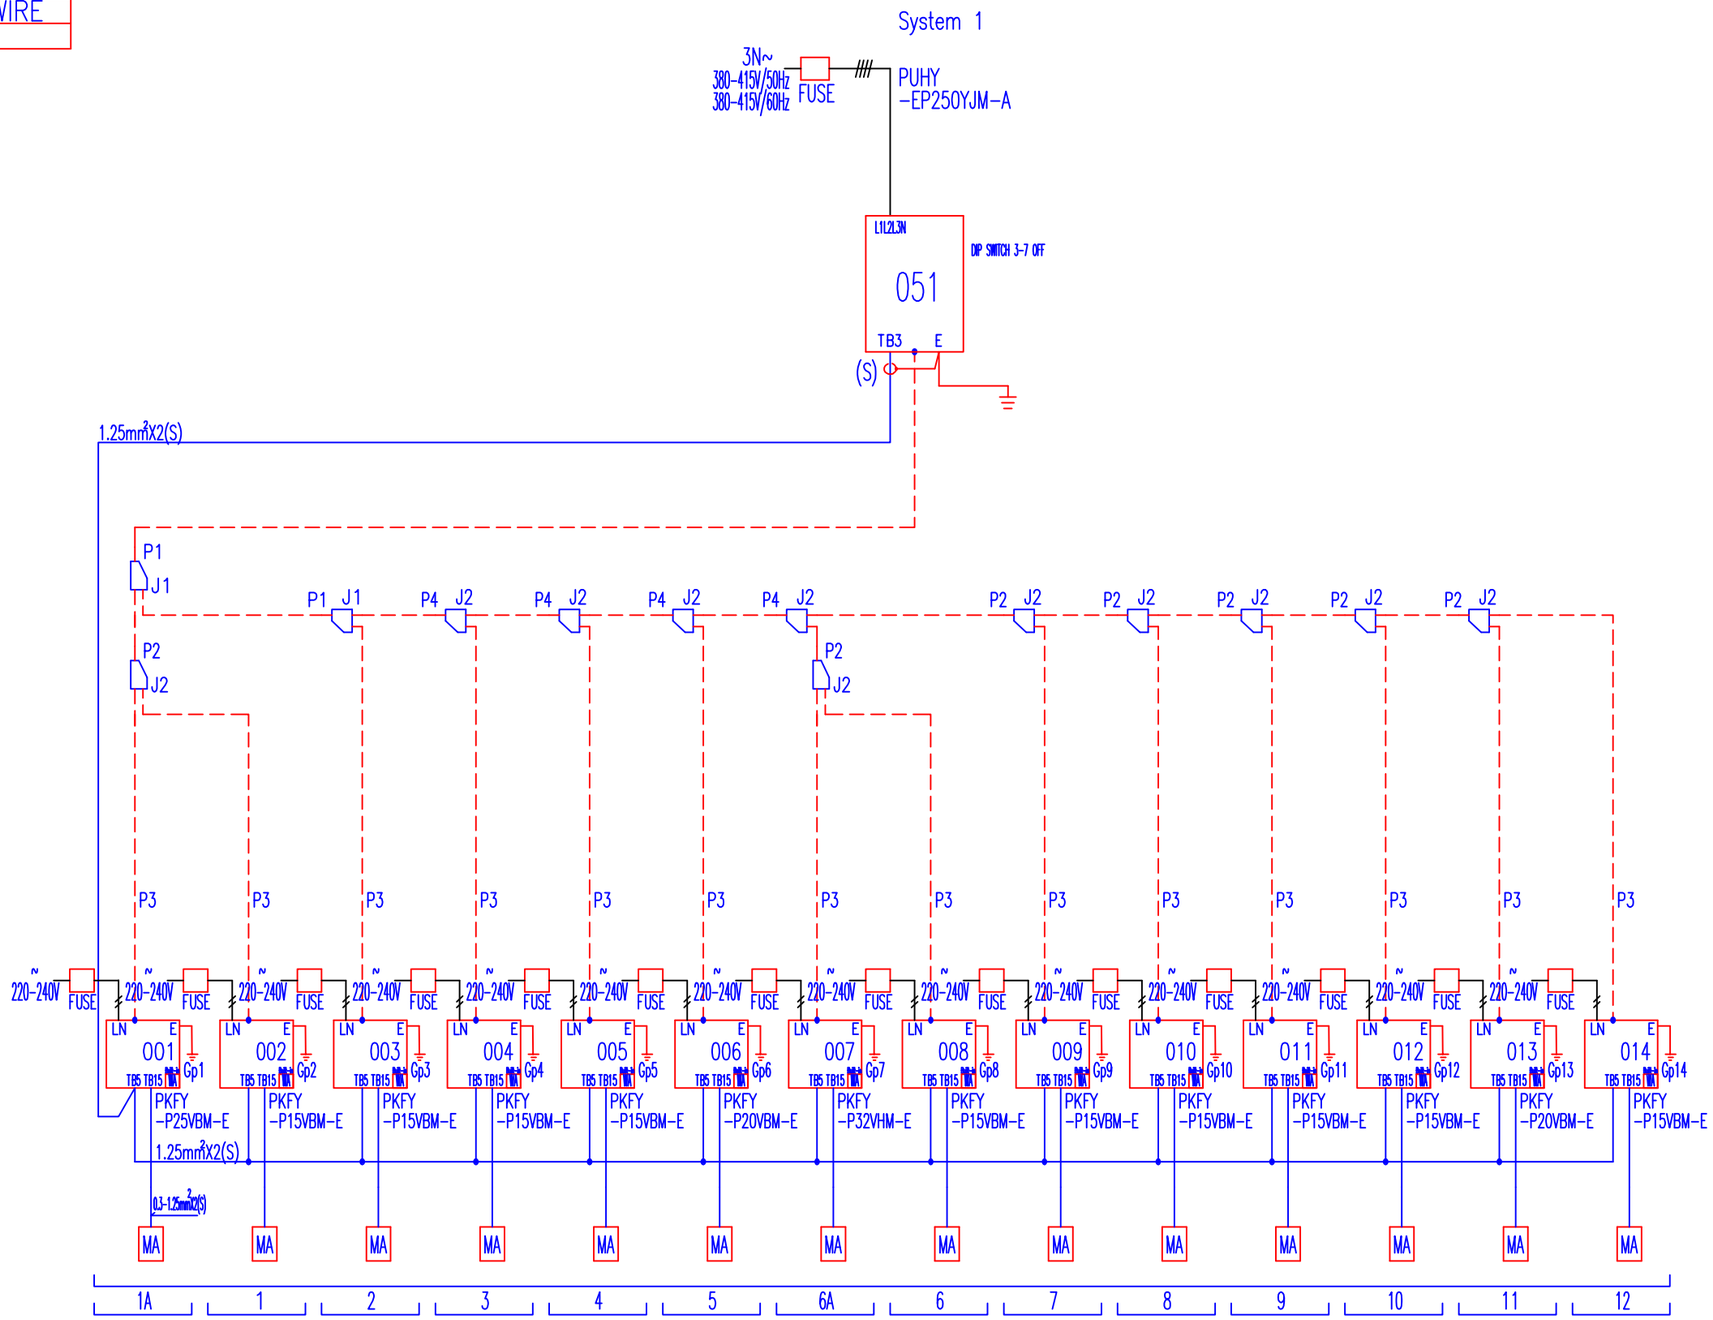

REMARKS

Rys. 3 – Schemat połączenia (rurowego i elektrycznego) urządzeń w instalacji klimatyzacyjnej

MITSUBISHI ELECTRIC CORPORATION

PREPARED ON 2014/06/30